

Memo No: 27.29.0000.012.07.015.21-420

Date: 01/04/2021

Sub: Minutes of the Pre-Tender Meeting and 1st Amendment of Tender Document on Ref. No. 27.29.0000.012.07.015.21-255 Issued on 10.02.2021 for Procurement of “Design, Supply, Erection, Installation, Testing and Commissioning of Upgradation of Shibbati, Shantahar, Rahmannagar, Nurpur, Bahirgola and Raypur, 33/11 KV Substation on Turnkey Basis under Rajshahi Power Distribution Development Project (ICT)”.

A Pre-Tender Meeting was held on 01-04-2021 on Ref. No. 27.29.0000.012.07.015.21-255 issued on 10.02.2021 for Procurement of “Design, Supply, Erection, Installation, Testing and Commissioning of Upgradation of Shibbati, Shantahar, Rahmannagar, Nurpur, Bahirgola and Raypur, 33/11 KV Substation on Turnkey Basis under Rajshahi Power Distribution Development Project (ICT)”. The following Explanation/Amendment has been made on the basis of Pre-Tender Meeting discussion in the presence of prospective tenderers.

SL No	Clause No & Name	Queries/Written as	Explanation/Amendment
01	ITT 5.13	Tenderers shall have the following up-to-date valid License: ABC Category Electrical Supervisory License from Bangladesh Electrical Licensing Board & Trade/Business License.	Tenderers shall have the following up-to-date valid License: ABC Category Electrical Supervisory License & Trade/Business License.
02	ITT 14.1 (a) General Experience	The Tenderer shall have a minimum of Five (05) years of overall experience in the business of Supply, Installation, Erection, Testing, Commissioning of electrical substation in govt./semi govt./autonomous electricity utilities in Bangladesh in the role of contractor or management contractor (years counting backward from the date of IFT).	The Tenderer shall have a minimum of five (05) years of overall experience in the business of supply, Installation, Erection, Testing, Commissioning of electrical substation in electricity utilities in the role of contractor or management contractor (years counting backward from the date of IFT).
03	ITT 14.1 (b) Specific Experience	The minimum specific experience as a Contractor or Management Contractor in similar to the proposed plant and services in at least a number of 2 (two) contract(s) of similar nature*, complexity and	The minimum specific experience as a Contractor or Management Contractor in similar to the proposed plant and services in at least a number of 2 (two) contract(s) of similar nature*, complexity and methods/construction technology successfully completed within the

০৬

SL No	Clause No & Name	Queries/Written as	Explanation/Amendment
		<p>methods/construction technology successfully completed within the last 10 (ten) years (years counting backward from the date of IFT), each with a value of at least Tk. 19 Crore (BDT Nineteen Crore) in govt./semi govt./autonomous electricity utilities in Bangladesh.</p> <p>In addition, performance of the completed turnkey contracts and ongoing turnkey contract(s) as mentioned in Annexure: 5-1 and Annexure: 5-2 shall be taken into consideration during evaluation.</p> <p><u>Note:</u></p> <ol style="list-style-type: none"> 1. The Tenderer shall have to submit End User Certificate(s) in End User's official pad; in favor of above-mentioned experience stating that the performance of the supplied plant and services are satisfactory for at least one (01) year. 2. The End User Certificate(s) duly signed by the end user shall mention the name & commissioning date of the plant and services which were designed, supplied, installed/constructed, tested and commissioned by Tenderer (lead partner in case of JV) and shall contain end-user's full mailing address, e-mail address, website address, fax number and phone number for the convenience of authentication. In any case, NESCO reserve the right to verify genuineness of End User Certificate(s). 3. Certificate(s) those are not in Bangla/English must be notarized on translated English version. <p><i>*Similar nature means: Construction of 33/11kV or higher voltage level GIS/AIS/GIS+ AIS Substation and having capacity regarding engineering, supply, erection, installation, testing and commissioning of at least 2x10/13.33MVA or higher capacity substations on turnkey basis.</i></p>	<p>last 10 (ten) years (years counting backward from the date of IFT), each with a value of at least Tk. 19.00 (Nineteen) Crore in Electricity Utility.</p> <p>In addition, performance of the completed turnkey contracts and ongoing turnkey contract(s) as mentioned in Annexure: 5-1 and Annexure: 5-2 shall be taken into consideration during evaluation.</p> <p><u>Note:</u></p> <ol style="list-style-type: none"> 1. The Tenderer shall have to submit End User Certificate(s) in End User's official pad; in favor of above-mentioned experience stating that the performance of the supplied plant and services are satisfactory for at least one (01) year. 2. The End User Certificate(s) duly signed by the end user shall mention the name & commissioning date of the plant and services which were designed, supplied, installed/constructed, tested and commissioned by Tenderer (lead partner in case of JV) and shall contain end-user's full mailing address, e-mail address, website address, fax number and phone number for the convenience of authentication. In any case, NESCO reserve the right to verify genuineness of End User Certificate(s). 3. Certificate(s) those are not in Bangla/English must be notarized on translated English version. 4. Electricity Utility means an organization/company that engages in electricity generation/ transmission / distribution of electricity for sale in a regulated market. <p><i>*Similar nature means: Construction of 33/11kV or higher voltage level GIS/AIS/GIS+ AIS - Substation and having capacity regarding engineering, supply, erection, installation, testing and commissioning of at least 2x10/13.33MVA or higher capacity substations on turnkey basis.</i></p>
04	ITT 24.2(r)-12	<p>At least 02 (two) nos. Manufacturer's Satisfactory Performance Certificates from Electricity Utility as End User depicting that each offered type or higher capacity rating Power Transformer, 33kV Outdoor VCB, 33kV PCM Panel, 11kV VCB with PCM Panel, Battery & Battery Charger, 11kV XLPE Power Cable, 33kV & 11kV LA, CT & PT of same voltage class within last 10 (ten) years i.e. years counting backward from the date of publication of IFT in the newspaper and has been in satisfactorily service for at least 02(two) years. The Satisfactory Performance Certificate (SPC) shall be in End User's official pad and shall contain end-user's full mailing address, e-mail address, website address and fax / telephone number for the convenience of authentication.</p> <p><u>Note: Electricity Utility means govt./semi govt./autonomous electricity utilities engaged in Bangladesh.</u></p>	<p>At least 02 (two) nos. Manufacturer's Satisfactory Performance Certificates from Electricity Utility as End User depicting that each offered type or higher capacity rating Power Transformer, 33kV Outdoor VCB, 33kV PCM Panel, 11kV VCB with PCM Panel, Battery & Battery Charger, 11kV XLPE Power Cable, 33kV & 11kV LA, CT & PT of same voltage class within last 10 (ten) years i.e. years counting backward from the date of publication of IFT in the newspaper and has been in satisfactorily service for at least 02(two) years. The Satisfactory Performance Certificate (SPC) shall be in End User's official pad and shall contain end-user's full mailing address, e-mail address, website address and fax / telephone number for the convenience of authentication.</p> <p><u>Note: Electricity Utility means an organization/company that engages in electricity generation/ transmission / distribution of electricity for sale in a regulated market.</u></p> <p>Certificate(s) those are not in Bangla/English must be notarized on translated English version.</p>

PK

SL No	Clause No & Name	Queries/Written as	Explanation/Amendment
05	ITT 37.1	In addition to the original of the Tender, 3 (three) copies shall be submitted within the date and time mentioned in the Tender Notice.	In addition to the original of the Tender, 1(one) copy shall be submitted within the date and time mentioned in the Tender Notice. All documents must be book binding with page number & index.
06	Section -5 (Schedules of Rates and Prices) Schedule No. a (1) - Row no. 16, Schedule No. a(2) - Row no. 16, Schedule No. b (1) - Row no. 21, Schedule No. b(2) - Row no. 21, Schedule No. c (1) - Row no. 20, Schedule No. c(2) - Row no. 20, Schedule No. d (1) - Row no. 19, Schedule No. d(2) - Row no. 19, Schedule No. e (1) - Row no. 15, Schedule No. e(2) - Row no. 15, Schedule No. f (1) - Row no. 21, Schedule No. f(2) - Row no. 21, Section -6 (6.1.2.1 - Row no. 16, 6.1.2.2 - Row no. 21, 6.1.2.3 - Row no. 20, 6.1.2.4 - Row no. 19, 6.1.2.5 - Row no. 15, 6.1.2.6 - Row no. 21,) etc.	Supply of 11 KV 2000A, 31.5 KA for 3 sec Transformer incoming panel comprising 3 phase busbars 2500A including 11 KV CT (1800-900/5-5A), 11kv PT, 3 Over Current + 2 Earth Fault (1 EF + 1 REF) + Directional Over Current Relays, Ammeters, Voltmeters, kWh m. (As per scope of works, Technical Specification and GTP)	Supply of 11 KV Transformer incoming panel comprising 3 phase busbars 2500A, VCB 2000A (31.5 KA for 3 sec) ,11 KV CT (1800-900/5-5-5A), 11KV PT, 3 Over Current + 2 Earth Fault (1 EF + 1 REF) + Directional Over Current Relays, Ammeters, Voltmeters, kWh m and all other accessories as required. (As per scope of works, Technical Specification and GTP)
07	Section -5 (Schedules of Rates and Prices) Schedule No. a (1) - Row no. 17, Schedule No. a(2) - Row no. 17, Schedule No. b (1) - Row no. 22, Schedule No. b(2) - Row no. 22, Schedule No. c (1) - Row no. 21, Schedule No. c (2) - Row no. 21, Schedule No. d (1) - Row no. 20, Schedule No. d(2) - Row no. 20,	Supply of overhead 11 KV 630A, 31.5 KA for 3 sec Line Feeder panels, comprising 3 phase busbars 2500A, including 11 KV CT (200-400/5-5A),two pole OC and single pole EF Relays for IDMT protection, Ammeters, Voltmeters , kWh m, HV and LV isolating plug and sockets draw out type VCB with auxiliary switches operating mechanism etc (As per scope of works, Technical Specification and GTP)	Supply of 11 KV overhead Line Feeder panels comprising 3 phase busbars 2500A, VCB 630A (31.5 KA for 3 sec), 11 KV CT (200-400/5-5A) two pole OC and single pole EF Relays for IDMT protection, Ammeters, Voltmeters, kWh m, HV and LV isolating plug and sockets draw out type VCB with auxiliary switches operating mechanism and all other accessories as required (As per scope of works, Technical Specification and GTP)

ans

SL No	Clause No & Name	Queries/Written as	Explanation/Amendment
	Schedule No. e (1) - Row no. 16, Schedule No. e(2) - Row no. 16, Schedule No. f (1) - Row no. 22, Schedule No. f(2) - Row no. 22, Section -6 (6.1.2.1 - Row no. 17, 6.1.2.2 - Row no. 22, 6.1.2.3 - Row no. 21, 6.1.2.4 - Row no. 20, 6.1.2.5 - Row no. 16, 6.1.2.6 - Row no. 22) etc.		
08	Section -5 (Schedules of Rates and Prices) Schedule No. c (1) - Row no. 22, Schedule No. c (2) - Row no. 22, Schedule No. d (1) - Row no. 21, Schedule No. d(2) - Row no. 21, Schedule No. e (1) - Row no. 17, Schedule No. e(2) - Row no. 17, Schedule No. f (1) - Row no. 23, Schedule No. f(2) - Row no. 23, Section -6 (6.1.2.3 - Row no. 22, 6.1.2.4 - Row no. 21, 6.1.2.5 - Row no. 17, 6.1.2.6 - Row no. 23) etc.	Supply of 11 KV 2000A, 31.5 KA for 3 sec bus-coupler panel with bus raiser including 11 KV CT (1800-900/5-5-5A), 2 Over Current + 1 Earth Fault and all other accessories as required (As per scope of works, Technical Specification and GTP)	Supply of 11 KV bus-coupler panel with bus raiser comprising 3-Phase bus bars 2500A, VCB 2000A (31.5 KA for 3 sec), 11 KV CT (1800-900/5-5-5A), 2 Over Current + 1 Earth Fault and all other accessories as required (As per scope of works, Technical Specification and GTP)
09	GTP No-8.03 Sl. No-100	The PCM Panel Shall be complied all the technical specification mentioned in Section-7	The PCM Panel Shall be complied all the technical specifications mentioned in Section-7 and GTP no-8.11 & 8.13
10	GTP No-8.11	Guaranteed Technical Particulars of 11kV Indoor Bushing /Ring Type Single Phase Current Transformer for regular substation	Guaranteed Technical Particulars of 11KV Indoor Bushing /Ring Type Single Phase Current Transformer for regular substation (11 KV switchgear)
11	GTP No-8.13	Guaranteed Technical Particulars of 11kV Indoor Type Single Phase Potential Transformer for regular substation	Guaranteed Technical Particulars of 11kV Indoor Type Single Phase Potential Transformer for regular substation (11 KV switchgear)


26

SL No	Clause No & Name	Queries/Written as	Explanation/Amendment																												
12	Section - 8.05 Guaranteed Technical Particulars of 11kV Pole mounted Off-Load Isolator with Earth Blade (Newly Added)		<p>Following Rows to be added</p> <table border="1"> <tr> <td>Current density at the minimum cross Section of a) Moving Blade b) Terminal Pad c) Contacts d) Terminal Connector</td> <td>Amps/Sq.mm</td> <td>To be mentioned</td> <td></td> </tr> <tr> <td>Maximum Temp. rise of current carrying parts when carrying rated current continuously (deg. C)</td> <td>deg. C</td> <td>To be mentioned</td> <td></td> </tr> </table>	Current density at the minimum cross Section of a) Moving Blade b) Terminal Pad c) Contacts d) Terminal Connector	Amps/Sq.mm	To be mentioned		Maximum Temp. rise of current carrying parts when carrying rated current continuously (deg. C)	deg. C	To be mentioned																					
Current density at the minimum cross Section of a) Moving Blade b) Terminal Pad c) Contacts d) Terminal Connector	Amps/Sq.mm	To be mentioned																													
Maximum Temp. rise of current carrying parts when carrying rated current continuously (deg. C)	deg. C	To be mentioned																													
13	Section 8 - GTP of connectors: 8.03 [Row No:76]	Internal Arc Classification IAC A FLR- 31.5 KA for 1 sec	Internal Arc Classification IAC A FLR- 31.5 KA for 1 sec (Must be supported by type test report from any short-circuit testing liaison (STL) Member [http://www.stl-liaison.org/web/03_Members.php] Testing Organization or Laboratory as per relevant IEC standard).																												
14	Section 8 - GTP of connectors: 8.38 (Newly Added)	-	<p>GTP & Drawing of all the required connectors has to be provided. Here for example; GTP & Drawing of T-TYPE CONNECTOR (36/25 mm) has been provided. Few other connectors are - 33 KV FLAT I-TYPE CONNECTOR (25 mm), 33 KV Double I-TYPE CONNECTOR (25/25 mm), 33 KV Double I-TYPE CONNECTOR (36/25 mm), PG Clamp (ACSR Grosbeak) etc. If any other type connectors are to be used, then GTP & Drawing of the same items must be provided. Dimensions of all the connectors have to be similar to the attached drawing here. Dimensions of connectors are subject to approval from NESCO.</p> <p>GUARANTEED TECHNICAL PARTICULARS (GTP) FOR 33 KV T-TYPE CONNECTOR (36/25 mm)</p> <table border="1"> <thead> <tr> <th>Sl. No.</th> <th>Description</th> <th>NESCO's Requirement</th> <th>Manufacturer's Particulars</th> </tr> </thead> <tbody> <tr> <td colspan="4">Compatible for ACSR MARTIN to ACSR GROSBK</td> </tr> <tr> <td>1.</td> <td>Name & Address of the Manufacturer</td> <td>Shall be mentioned</td> <td></td> </tr> <tr> <td>2.</td> <td>Manufacturer's Code No.</td> <td>Shall be mentioned</td> <td></td> </tr> <tr> <td>3.</td> <td>Applicable Standard</td> <td>BS, IEC, BDS or equivalent international standard</td> <td></td> </tr> <tr> <td>4.</td> <td>Installation</td> <td>Outdoor and shall be installed for the above-mentioned conductor.</td> <td></td> </tr> <tr> <td>5.</td> <td>Type</td> <td>Bolted Type</td> <td></td> </tr> </tbody> </table>	Sl. No.	Description	NESCO's Requirement	Manufacturer's Particulars	Compatible for ACSR MARTIN to ACSR GROSBK				1.	Name & Address of the Manufacturer	Shall be mentioned		2.	Manufacturer's Code No.	Shall be mentioned		3.	Applicable Standard	BS, IEC, BDS or equivalent international standard		4.	Installation	Outdoor and shall be installed for the above-mentioned conductor.		5.	Type	Bolted Type	
Sl. No.	Description	NESCO's Requirement	Manufacturer's Particulars																												
Compatible for ACSR MARTIN to ACSR GROSBK																															
1.	Name & Address of the Manufacturer	Shall be mentioned																													
2.	Manufacturer's Code No.	Shall be mentioned																													
3.	Applicable Standard	BS, IEC, BDS or equivalent international standard																													
4.	Installation	Outdoor and shall be installed for the above-mentioned conductor.																													
5.	Type	Bolted Type																													

car

SL No	Clause No & Name	Queries/Written as	Explanation/Amendment			
			6.	Material	Aluminium Alloy (LM6 or higher grade)	
			7.	Minimum continuous current rating at 35°C rise over 40°C ambient temperature (75°C)	Shall be mentioned and capable of carrying the continuous current of the specified conductor in Amps.	
			8.	All Dimensions, Dia and Hole Size	Shall be as per drawing (Drg. No. 7.2) (To be confirmed)	
			9.	Weight of 100 nos. in Kg	Shall be mentioned	
			10.	Dimensional Drawing	Shall be enclosed	

DRAWING OF 33 KV T-TYPE CONNECTOR (36/25 mm)

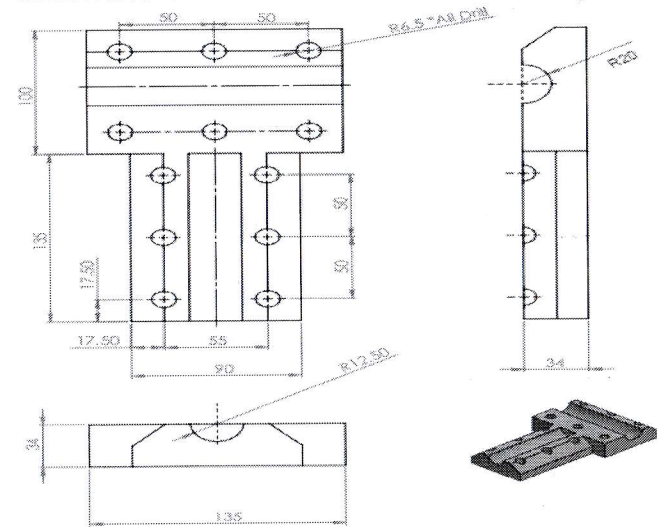

26

15	Section -8 GTP 8.18 - Row No. - 10.4	NEUTRAL BUSHING CTS 11 KV FOR SEF & REF PROTECTION Ratio - 1800/5 A	NEUTRAL BUSHING CTS 11 KV FOR SEF & REF PROTECTION Ratio - 1800/5/5 A
----	---	--	--

(Signature)
01.04.21
(Md. Mizanur Rahman)
Superintending Engineer
Procurement Department
NESCO, Rajshahi.

Copy to:

1. Managing Director, NESCO, Rajshahi.
2. Executive Director, Technical, NESCO, Rajshahi.
3. Chief Engineer, Services, NESCO, Rajshahi.
4. Project Director, Extension & Renovation Project of Distribution Line & Sub-Station for Rajshahi Division, Rajshahi.
5. Superintending Engineer, Design & Inspection, NESCO, Rajshahi.
6. Distribution to All Prospective Tenderers.
7. Office Copy.